


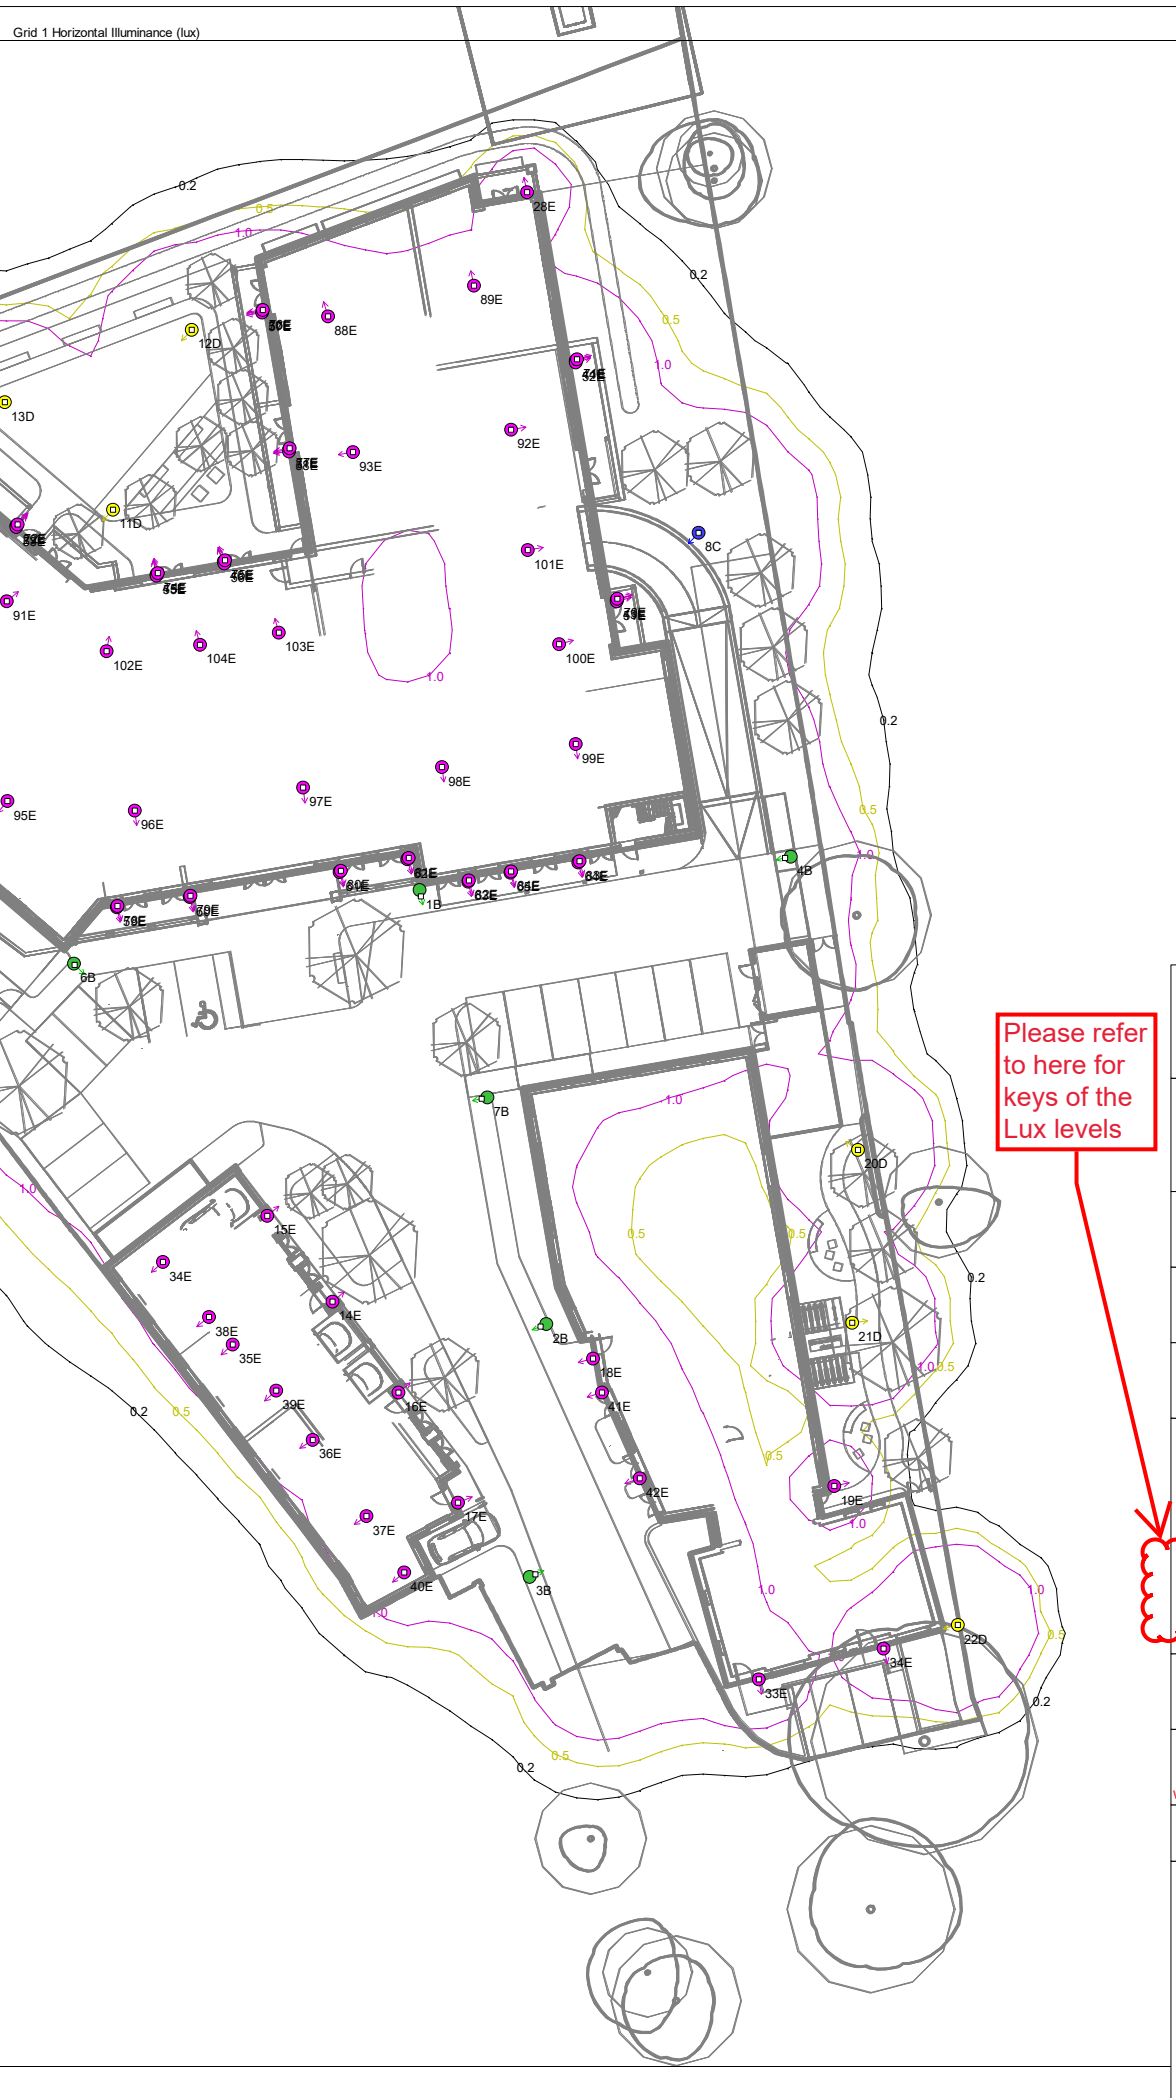
 Luminaire B	 Luminaire C	 Luminaire D	 Luminaire E
Supplier	TRT Lighting	D W Windsor	D W Windsor	Ligman
Type	ASM4_LED_14W_GA2_BS_3000_K_EXP	PM_DS_WW	PM_DS_WW	JE-30454-N-9030
Lamp(s)	42 0014 0000 100	9 x LUXEON Tx LED	9 x LUXEON Tx LED	1 LED 3000K
Lamp Flux (km)	1.47	1.51	1.51	0.34
Maintenance Factor	1.00	1.00	1.00	1.00
No. in Project	6	4	6	89



1. This originally submitted lighting strategy plan already demonstrates light spill of a Lux level that is complying with the 0-2 Lux requirement by the Environment Agency.

2. To further improve the situation and remove any remaining concern in this regard, these 3 lights as clouded will also be omitted.

Please refer to here for keys of the Lux levels



PROJECT NAME:
Orchard Lane, East Moseley

PROJECT No:
2455-DFL-ELG-XX-LD-EO-13001

SCALE: **1:500** DATE: **12 October 2022**

DESIGNER:
DFL-UK (AJB)

> Indicative light spill diagram.
> Not for construction.
> Initial light levels shown.
> Light spill diagram does not consider blocking or shading effects of light limiting objects and represents worst-case horizontal light spill at ground floor level.
> Light spill diagram to be read in conjunction with Lighting Strategy: 2455-DFL-ELG-XX-RP-EO-13001-S3

Isolux contours shown:
1.0Lux: Purple
0.5Lux: Yellow
0.2Lux: Black

CHECKED BY: **TP** APPROVED BY: **TP**

REVISION: **P02** SUITABILITY: **S3**
with notes by Lifestyle Residences

PREPARED BY:

Alex Brown
Lighting Designer
+44 (0)1962 855080
17-18 City Business Centre,
Winchester Hants,
SO23 7TA.
e-mail: alex.brown@df-uk.com
website: www.dfl-uk.com